
NOTES:

FABRICATE USING 3/16"X 1-1/2" ALUMINUM BAR GRATING NO VEHICLE OR FOOT TRAFFIC APPLICATION

PLEASE PROVIDE OPTIONAL PRICE USING 3/16"X 2" ALUMINUM BAR GRATING. (MAN HOLE RING IS 2" TALL)

ALUMINUM GRATING SHALL BE CONSTRUCTED FROM ALUMINUM ALLOY 6061-T6 AND 6063-T5 FOR STRUCTURAL SUPPORTS AND FRAMES IN ACCORDANCE WITH ASTM B221.

GRATINGS SHALL BE FURNISHED

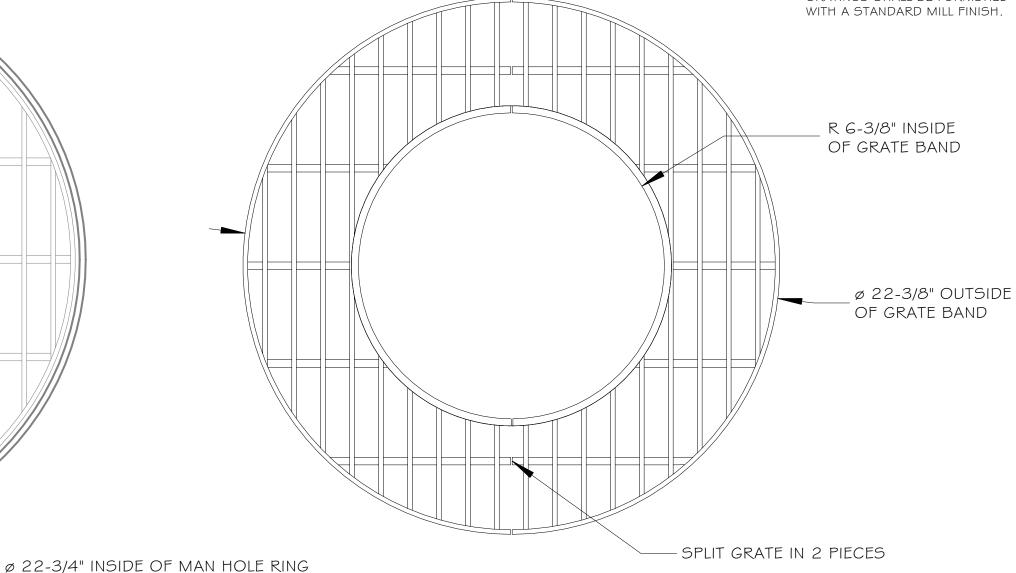

FABRICATION

APPLICATION

ø 10-3/4" O.D. OF PIPE

WALLA WALLA REPLACE WATER SYSTEM PHASE I WALLA WALLA VA MEDICAL CENTER PROJECT # 14-0924

OVERFLOW TANK GRATE

ADVANCED TECHNOLOGY CONSTRUCTION DAVID LOUX 253-606-6783