



SAVED: 4/12/2025 5:12:09 PM

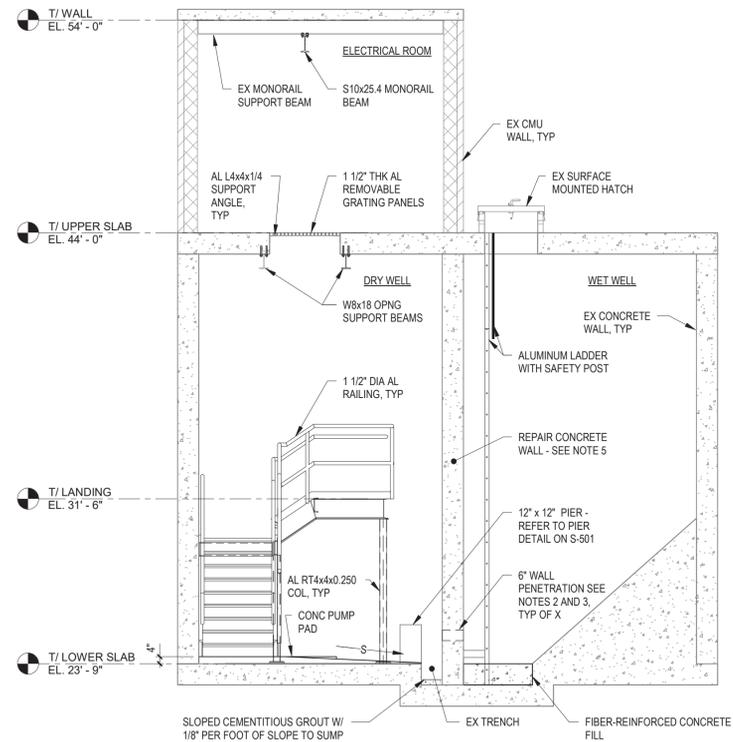

1 SECTION
1/4" = 1'-0"

SECTION NOTES:


1. FIELD VERIFY EXISTING CONDITIONS AND ELEVATIONS PRIOR TO PLACEMENT OF CONCRETE AND/OR FABRICATION AND PLACEMENT OF STEEL.
2. COORDINATE SIZE AND LOCATION OF SLAB AND WALL PENETRATIONS WITH ARCHITECTURAL, PLUMBING, HVAC, ELECTRICAL, AND MECHANICAL DRAWINGS.
3. EQUIPMENT PAD SIZES AND LOCATIONS ARE PROVIDED FOR BIDDING PURPOSES BASED ON INITIAL EQUIPMENT SELECTIONS. COORDINATE LOCATIONS AND SIZES WITH PURCHASED EQUIPMENT AND LAYOUT COMPLETED IN FIELD.
4. SLOPE DRY WELL SLAB TOWARDS EXISTING TRENCH AND SLOPE EXISTING TRENCH TO EXISTING SUMP PIT.
5. REPAIR CONCRETE WALL SEPARATING WET WELL AND DRY WELL TO STOP LEAKS.

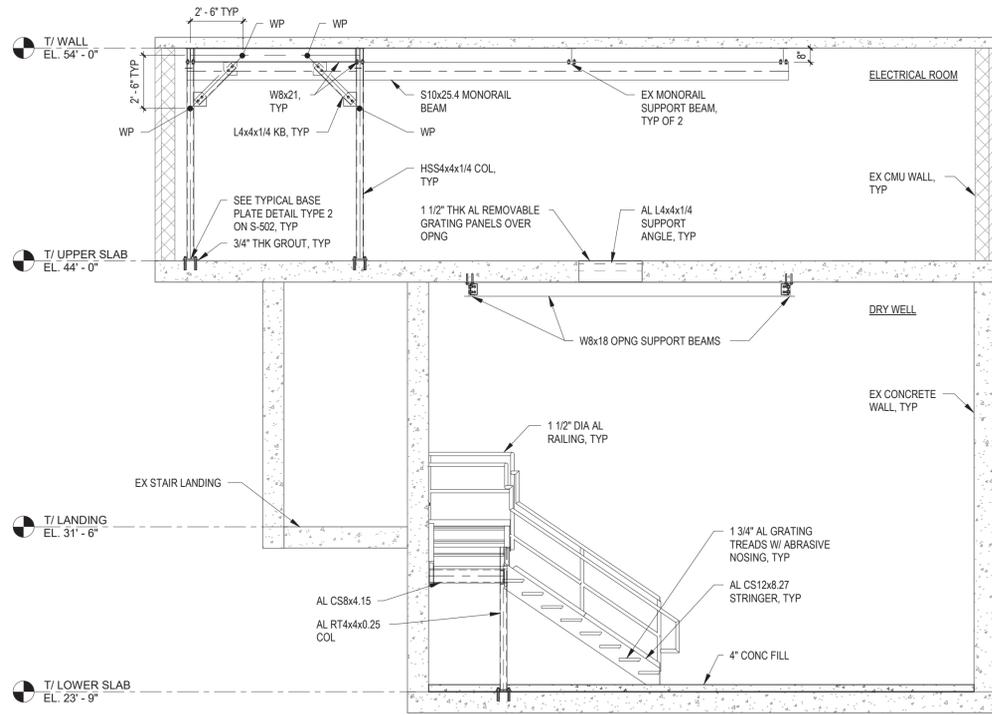


2 SECTION
1/4" = 1'-0"

SECTION NOTES:


1. FIELD VERIFY EXISTING CONDITIONS AND ELEVATIONS PRIOR TO PLACEMENT OF CONCRETE AND/OR FABRICATION AND PLACEMENT OF STEEL.
2. COORDINATE SIZE AND LOCATION OF SLAB AND WALL PENETRATIONS WITH ARCHITECTURAL, PLUMBING, HVAC, ELECTRICAL, AND MECHANICAL DRAWINGS.
3. EQUIPMENT PAD SIZES AND LOCATIONS ARE PROVIDED FOR BIDDING PURPOSES BASED ON INITIAL EQUIPMENT SELECTIONS. COORDINATE LOCATIONS AND SIZES WITH PURCHASED EQUIPMENT AND LAYOUT COMPLETED IN FIELD.
4. SLOPE DRY WELL SLAB TOWARDS EXISTING TRENCH AND SLOPE EXISTING TRENCH TO EXISTING SUMP PIT.
5. REPAIR CONCRETE WALL SEPARATING WET WELL AND DRY WELL TO STOP LEAKS.

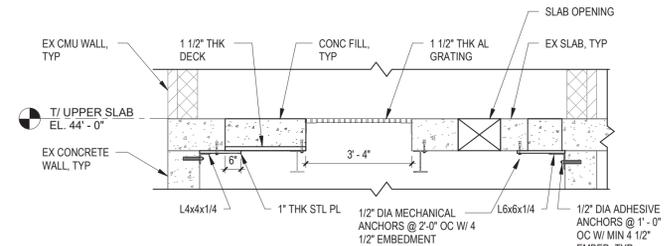

5 SECTION
3/8" = 1'-0"

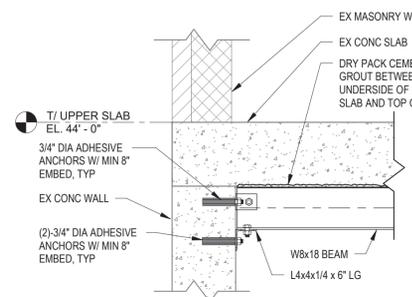


6 SECTION
3/4" = 1'-0"

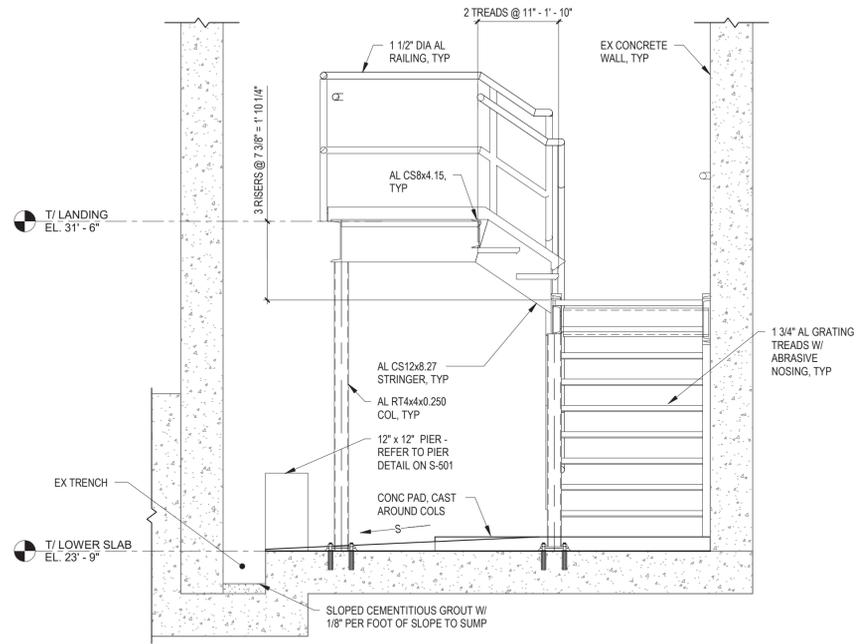

3 SECTION
1/2" = 1'-0"

SECTION NOTES:

1. FIELD VERIFY EXISTING CONDITIONS AND ELEVATIONS AND COORDINATE WITH DISCIPLINE REQUIREMENTS. EQUIPMENT MANUFACTURERS RECOMMENDATIONS OR REQUIREMENTS, EXISTING STRUCTURES AND GRADE (FINISHED FLOOR OR TOP OF SLAB) PRIOR TO PLACEMENT OF CONCRETE AND/OR FABRICATION AND PLACEMENT OF STEEL OR ALUMINUM.

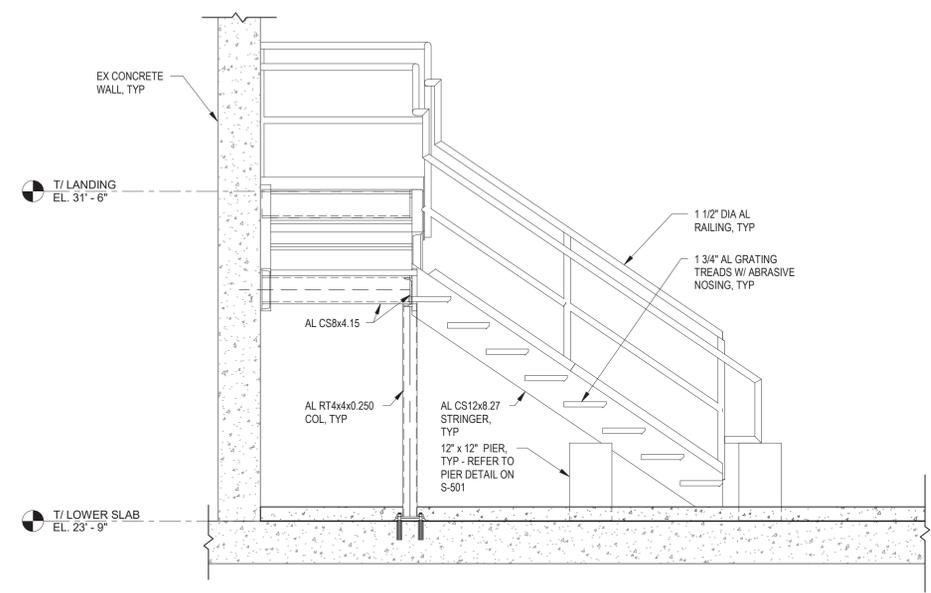

4 SECTION
1/2" = 1'-0"

SECTION NOTES:

1. FIELD VERIFY EXISTING CONDITIONS AND ELEVATIONS AND COORDINATE WITH DISCIPLINE REQUIREMENTS. EQUIPMENT MANUFACTURERS RECOMMENDATIONS OR REQUIREMENTS, EXISTING STRUCTURES AND GRADE (FINISHED FLOOR OR TOP OF SLAB) PRIOR TO PLACEMENT OF CONCRETE AND/OR FABRICATION AND PLACEMENT OF STEEL OR ALUMINUM.


515 Broadway, Albany, New York 12207
6047 Transit Road, Suite 103, East Amherst, NY 14051
28 Liberty Street, Fl 55, New York, NY 10005
3495 Winton Place, Bldg. C, Suite 1, Rochester, NY 14623
www.dasny.org

RAMBOLL

RAMBOLL AMERICAS ENGINEERING SOLUTIONS, INC.
333 WEST WASHINGTON STREET, SYRACUSE, NY 13202
(315) 466-4100

Watts Architects & Engineers

WATTS ARCHITECTS & ENGINEERS
255 GOLD STREET, SUITE 101, BROOKLYN, NY 11201

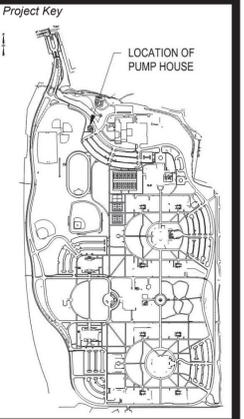

Revisions

Rev No	Description	Date
0	BID DOCUMENTS	4/3/2025

Client
NYS DORMITORY AUTHORITY

Project Title
CSI MAIN PUMP HOUSE REHABILITATION

Drawing Title
MAIN PUMP STATION MODIFICATION SECTIONS

Phase
BID DOCUMENTS

Professional Seal & Signature
Date: 4/3/2025
DASNY Project No: 3788709999
Consultant Project No: 1940107497
Scale: AS NOTED
Drawn By: NSY
Checked By: TVK



APR-01-2025
Date of License Expiration: 03/31/2026

S-303
Drawing Number Drawing 26 of 71

